


08.L 501
BLAD B12
1:100
30_09_15
09_10_15
18_11_15
26_11_15
08_01_16

ONTVANGEN 2 5 JAN 2016

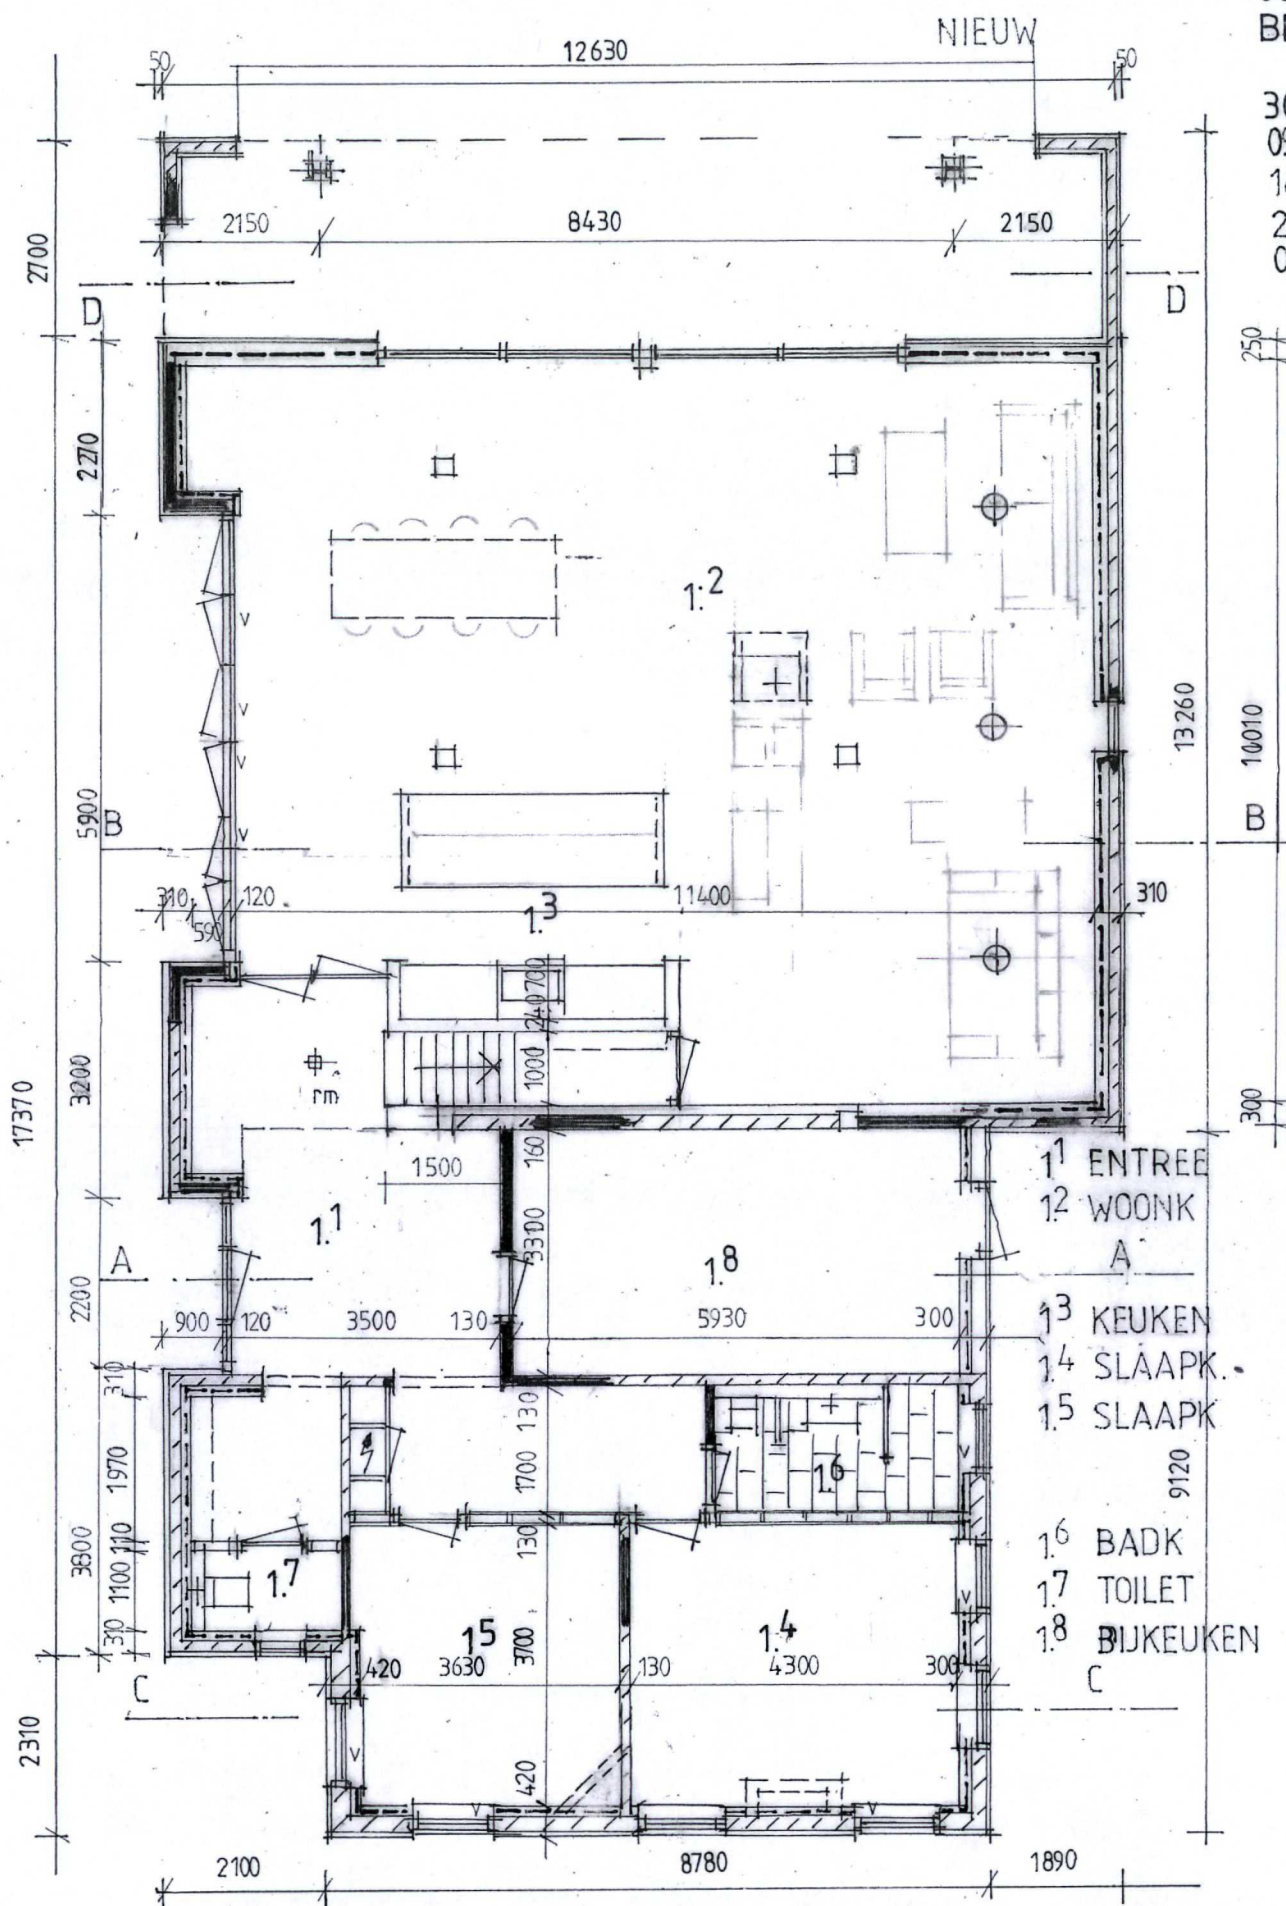

BEGANEGROND

⊕-rm rookmelder volgens NEN 2555


INBRAAKWERENDHEID
vlgs NEN 5096 weerst.kl.2

© ing. frits everts design

NIEUW

08_L_501
BLAD B13
1:100
30_09_15
09_10_15
18_11_15
26_11_15
08_01_16

ONTVANGEN 25 JAN 2016

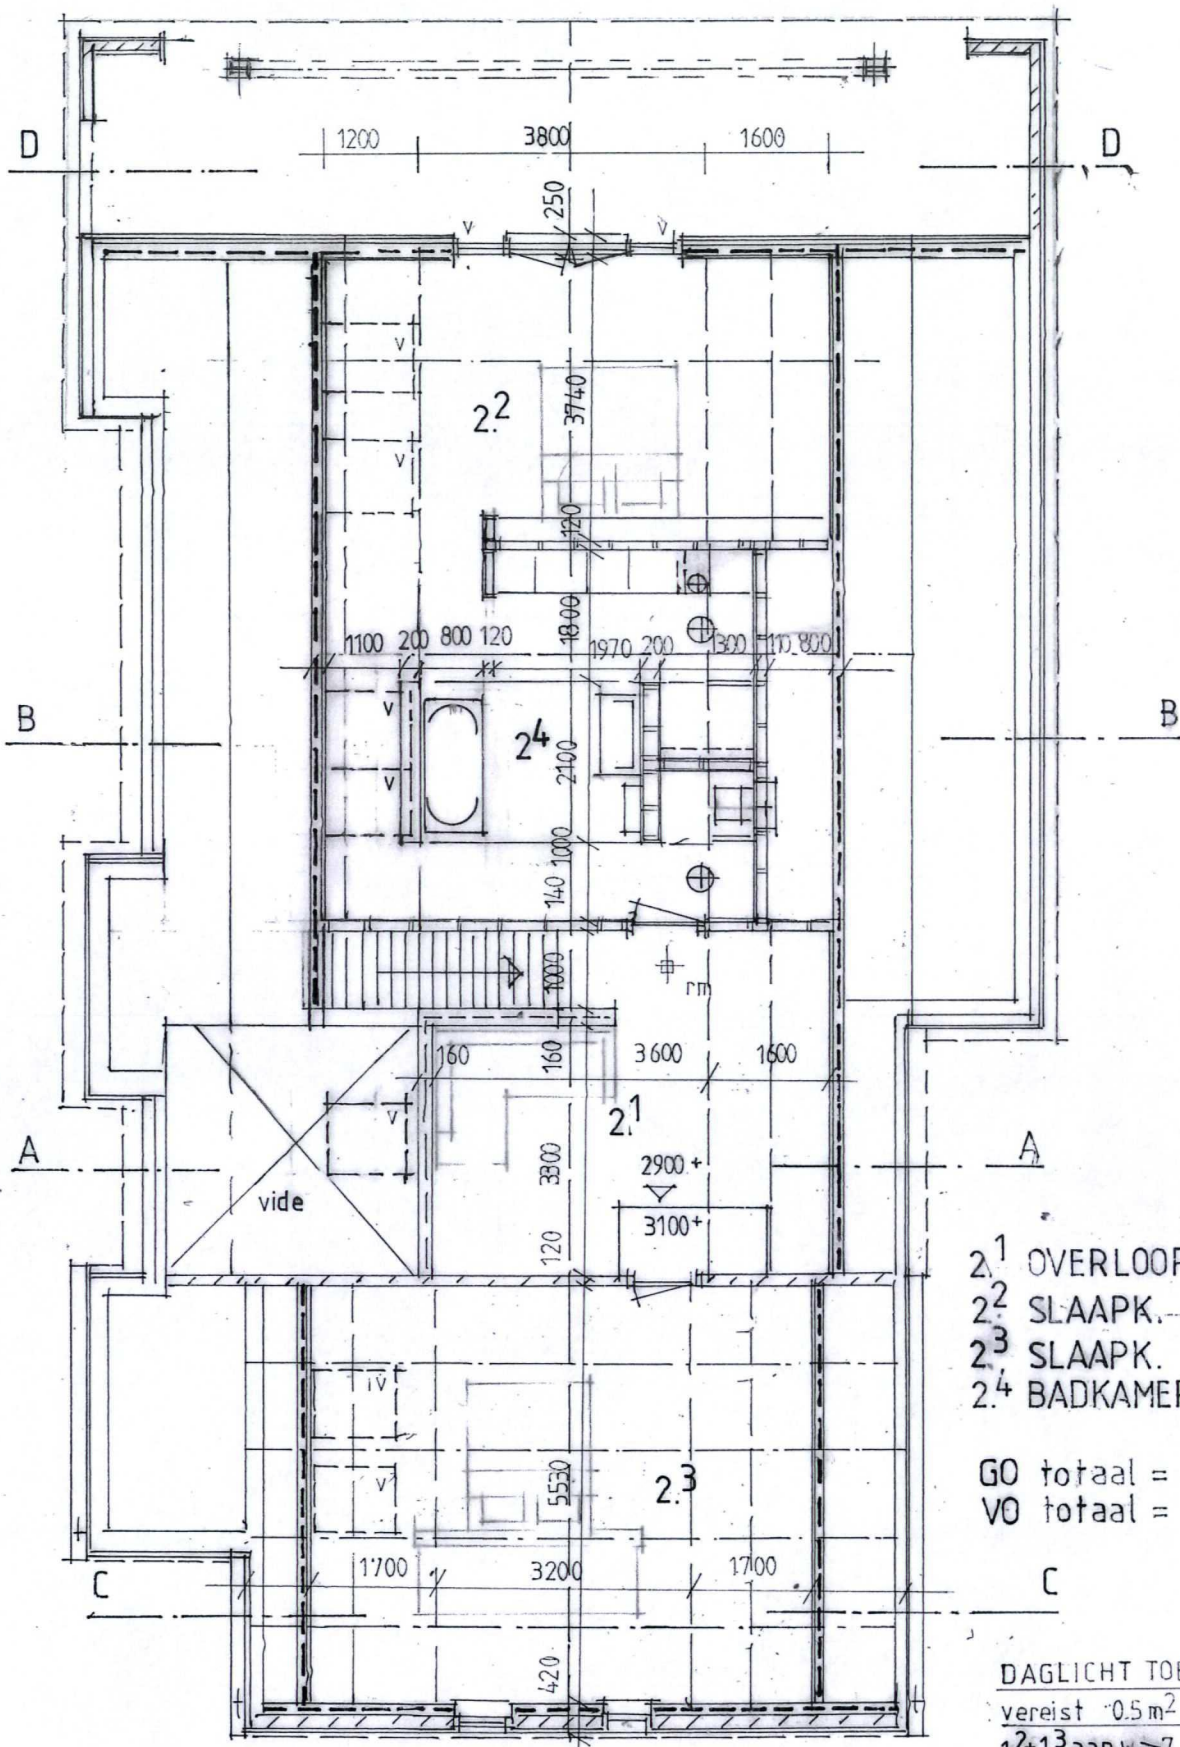

VERDIEPING

2.1	OVERLOOP	14 m ²	GO
2.2	SLAAPK.	14 m ²	VO
2.3	SLAAPK.	17 m ²	VO
2.4	BADKAMER	8 m ²	GO

GO totaal = 226.61 m²
VO totaal = 161.24 m²

DAGLICHT TOETREDING

vereist 0.5 m² per verblijfsruimte

1.2+1.3	aanw > 7 m ²	voldoet
1.4	aanw > 5 m ²	voldoet
1.5	aanw > 4 m ²	voldoet
2.2+2.4	aanw > 3 m ²	voldoet
2.3	aanw > 2 m ²	voldoet